




## CHARACTERISTICS

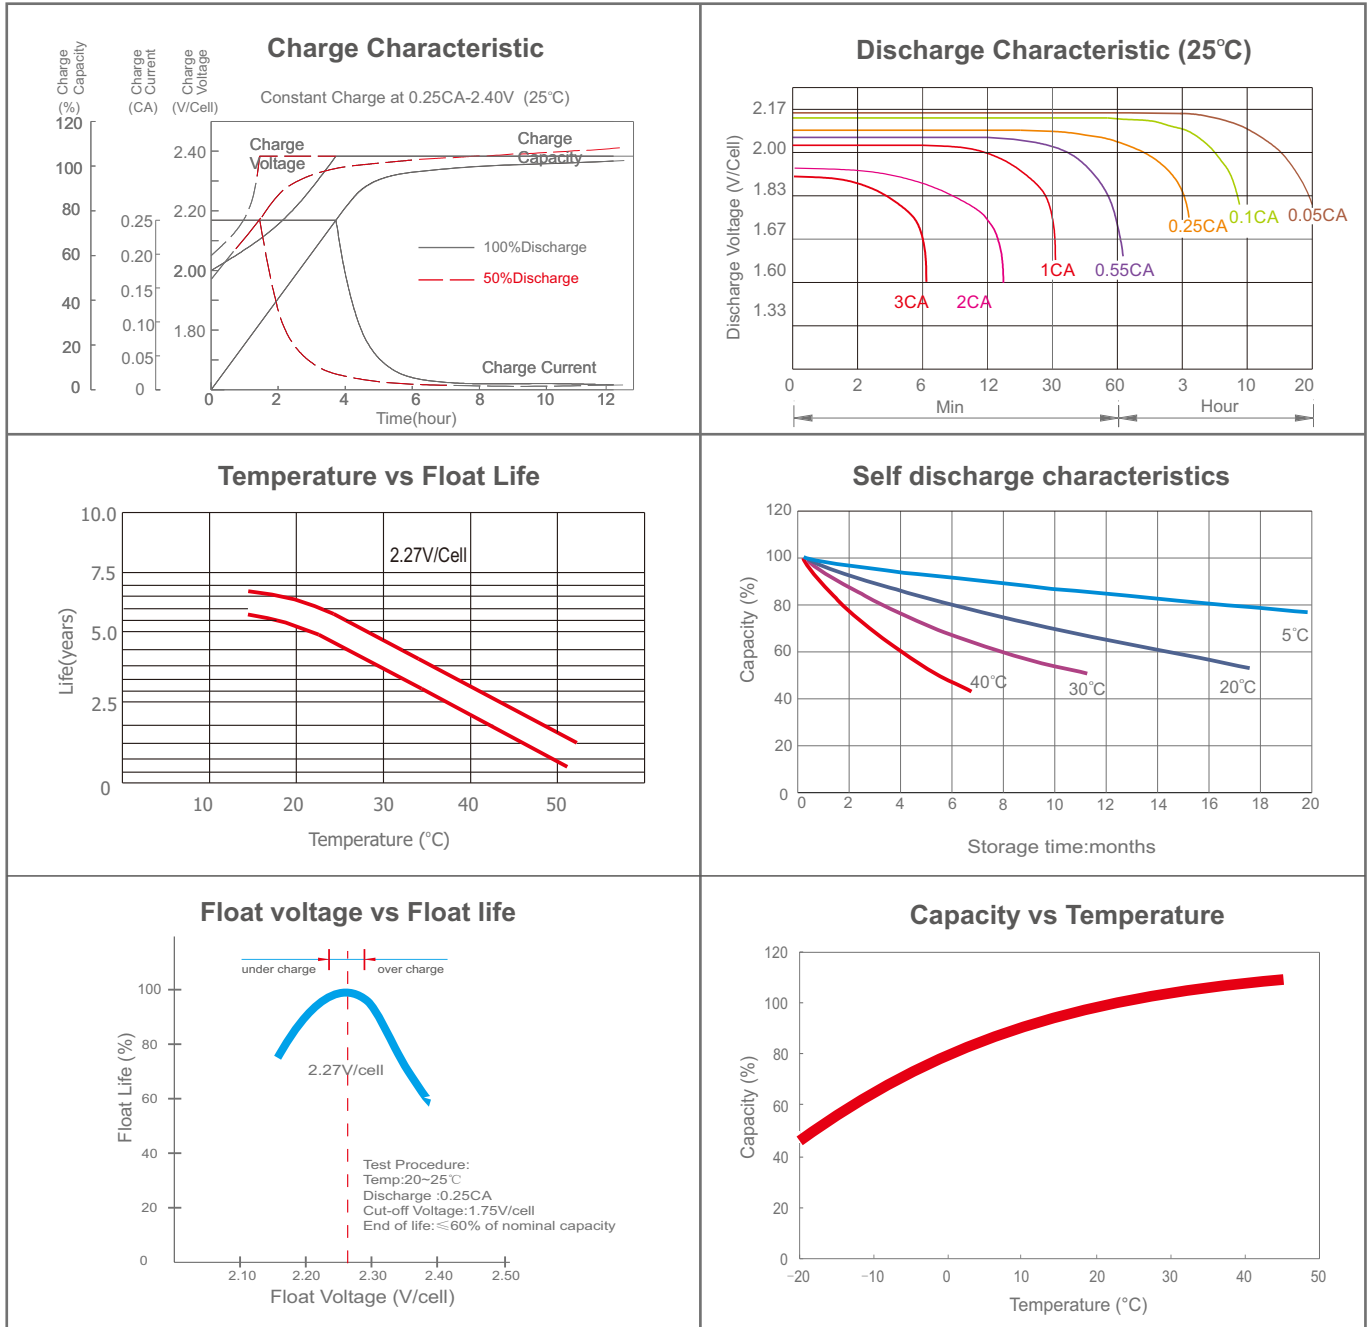

### FINAL VOLTAGE SETTINGS RECOMMENDED ACCORDING TO THE DISCHARGE CURRENT

Discharge Current I (A)	$I < 0.08C$	$0.08C \leq I < 0.2C$	$0.2C \leq I < 0.6C$	$0.6C \leq I < 1.0C$	$I \geq 1.0C$
Final of Voltage	$\geq 1.85V_{pc}$	$\geq 1.80V_{pc}$	$\geq 1.75V_{pc}$	$\geq 1.70V_{pc}$	$\geq 1.60V_{pc}$

BSB Power Company Limited  
 BSB NewEnergy Company Limited  
 Floor 2,Block A3,Nanshan I park,  
 No 1001 Xueyuan Road, NanShan District, P.O. 518057, Shenzhen, China  
 Tel: +86 755 8204 9972 Fax: +86 755 8362 1580  
 Website:www.bsbpower.com Email:equiry@bsbpower.com

